


# Kinsman 201 Facility Planning Area Wastewater Treatment Options



- ⊗ WWTP
- FPA Boundary
- Currently sewered
- On-site non-discharging systems
- Transitional areas

0 0.225 0.45 0.9  
Miles

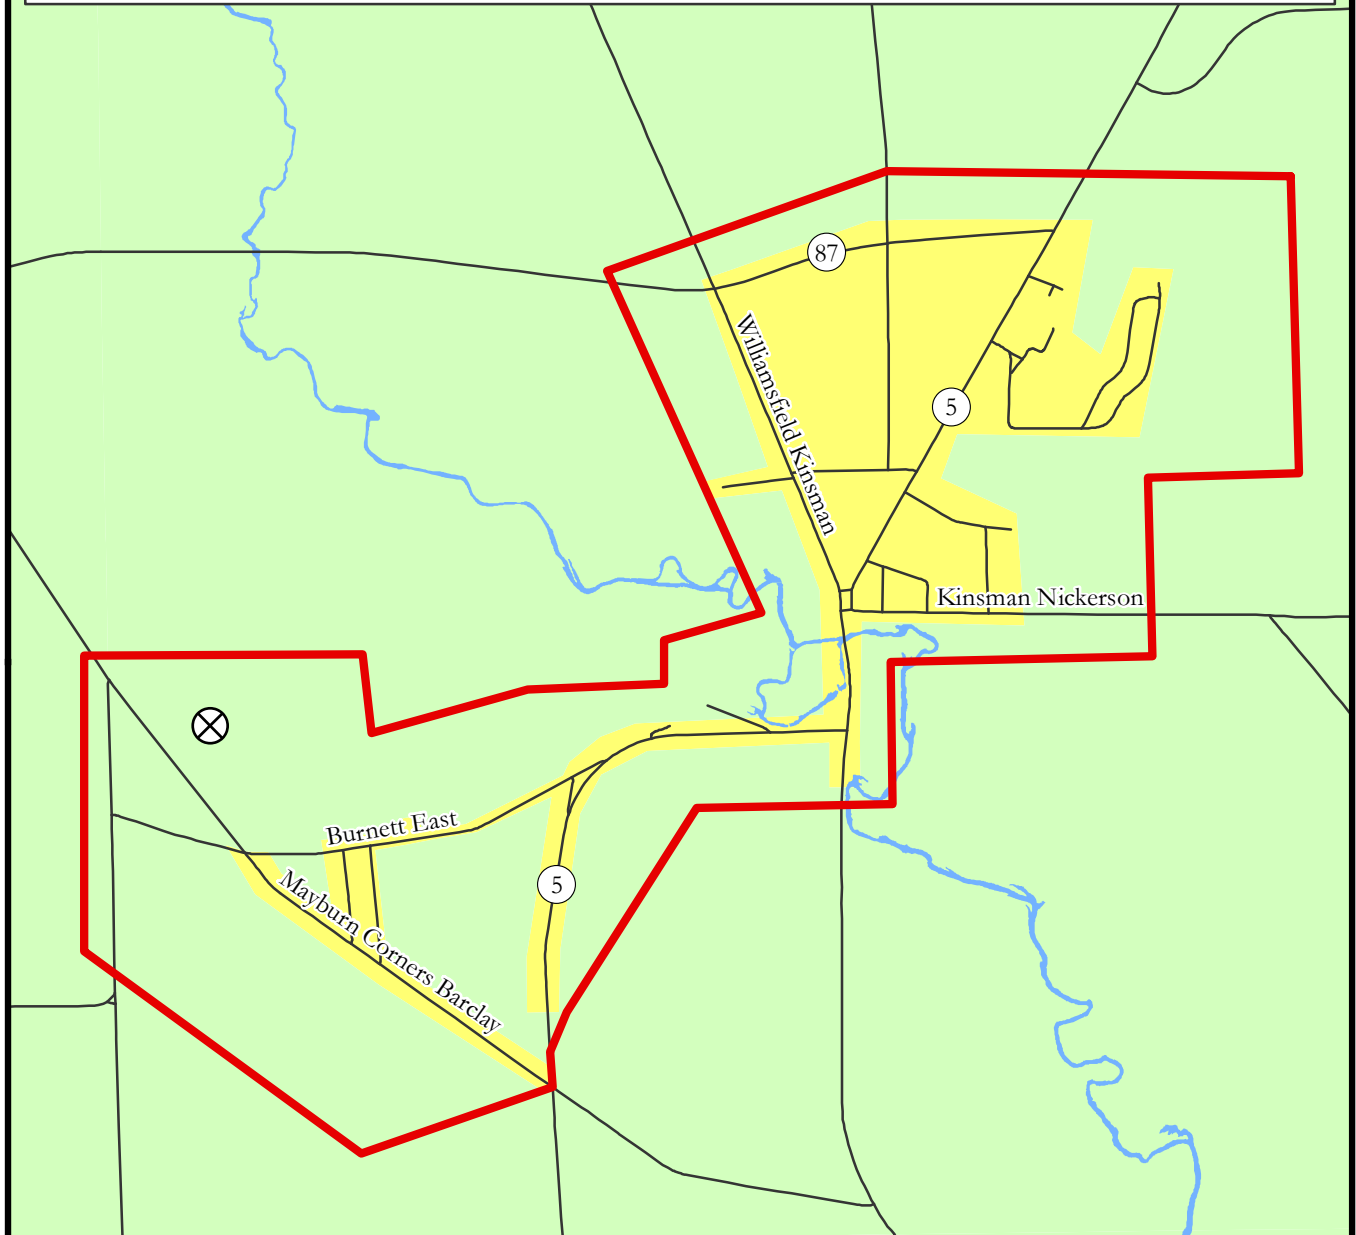

**EASTGATE**  
Regional Council of Governments